


GT4 Grease Interceptor passive/biological specification

Main Tank Dimensions

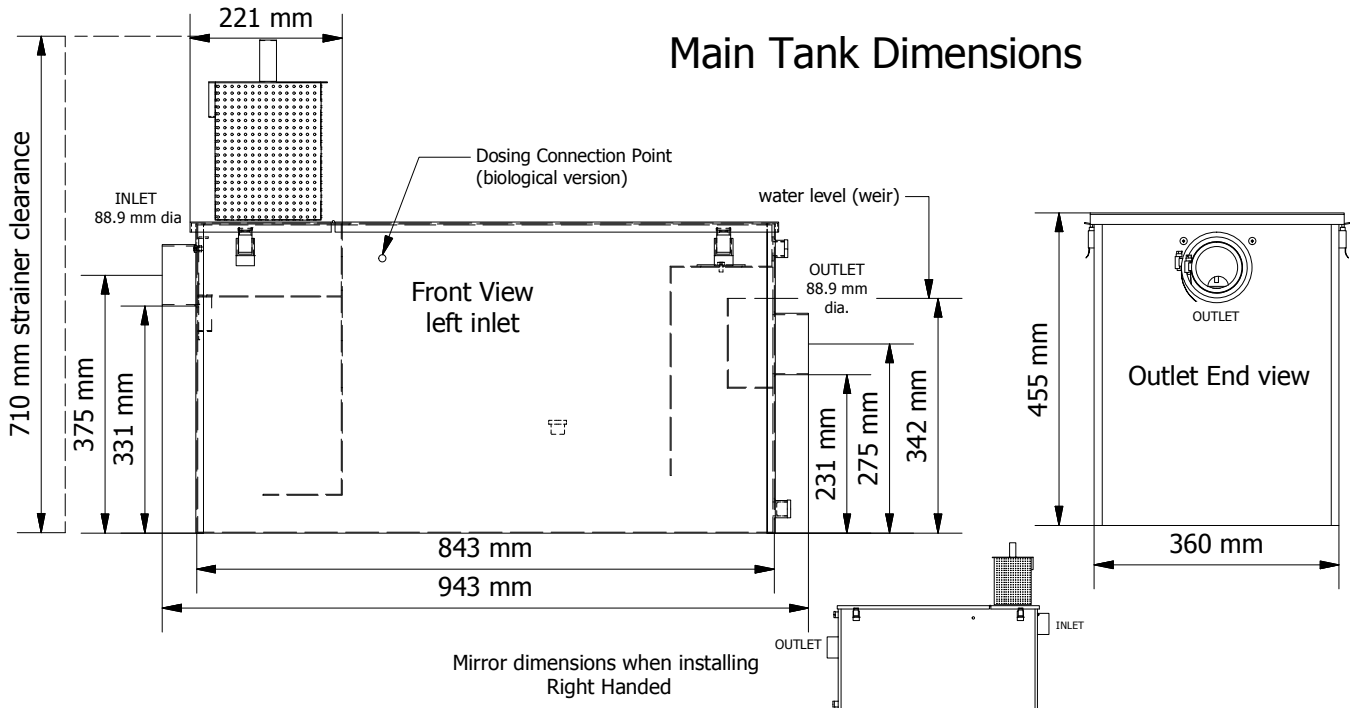

Minimum Footprint Dimensions When Installed


when using 3-2 inch pipe reducers

NOTES:

Allow for the minimum clearances shown including plumbing bend attachments (excluded)

Allow additional 150mm length clearance for outlet sampling port where applicable

Ensure access to strainer basket, located at inlet side of unit

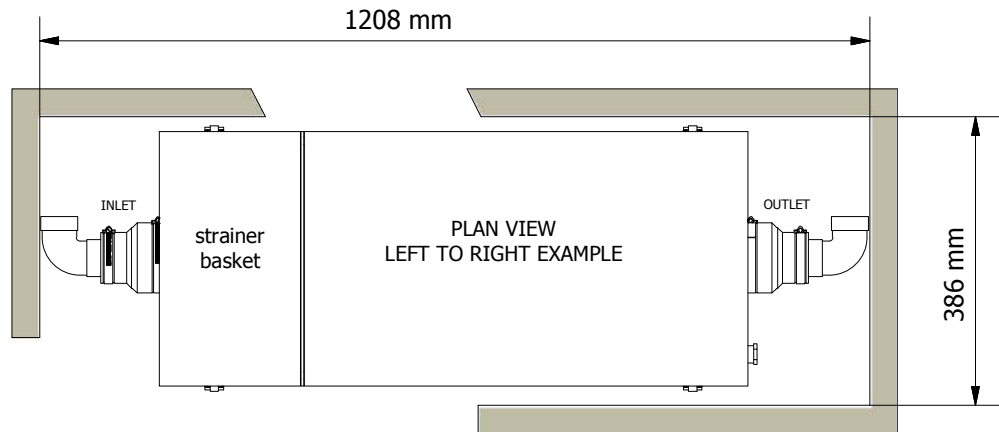

TECHNICAL DATA

Weight	30 KG
Tank Material	stainless steel, 1.5mm, X6 CrNi1810
Meals per Day Rating	180
Maximum sink capacity served	170 litres
Maximum Flow Rate served	2.75 litres per second
Grease Retention Capacity	42.5 kg
Solid Strainer Capacity	10.0 litres
Strainer Basket maintenance	Empty 1-2 times daily
Tank Pump out Frequency - passive unit	1 x 15 days
Tank Pump out Frequency - biological unit	1 x 60 days
Fluid dosage rate - biological unit	10.8 litres per month

Sizing data is calculated using ASME 112.14.3 & PDI G101 standards